


**QUICK GS PFA16 DN1000-2000 - Reinforced version**




DN flange (mm)	ØDE (mm)	ØDE mini (mm)	ØDE maxi (mm)	DE tolerance (mm)	A (mm)	B (mm)	D (mm)	X (mm)	d (mm)	Bolts	Mass (kg)	References
1000	1048	1041	1050	+2/-7	300	355	1195	105	1056	M20x90	280	*
1100	1151	1144	1153	+2/-7	300	365	1300	105	1160	M20x100	330	*
1200	1255	1247.5	1258	+3/-7.5	300	365	1425	130	1265	M24x100	420	*
1400	1462	1454.5	1465	+3/-7.5	320	395	1650	175	1472	M24x120	502	*
1500	1565	1557	1567.5	+2.5/-8	350	425	1770	175	1575	M27x120	784	*
1600	1668	1660	1670.5	+2.5/-8	350	425	1845	170	1680	M27x120	662	*
1800	1875	1866.5	1877	+2/-8.5	350	425	2075	185	1885	M27x120	865	*
2000	2082	2072.5	2083	+1/-9.5	400	475	2290	190	2092	M27x120	1250	*

(\*) contact us

DN1000-1600

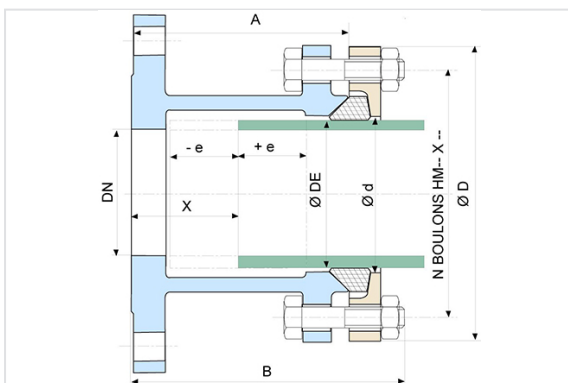


DN1200-2000

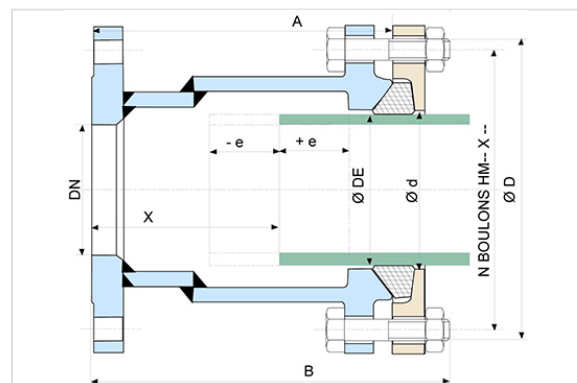

## Installation

- DE margin for assembly pipe: see table Dimensions DE  $\pm$  (margin for not ovalized pipe). Check that the pipe, to input in the Quick, is not ovalized more than 3mm and that the DE dimension with ovalization is not out of the margin. If not it is necessary to proceed re-rounding pipe (see catalogue WATER MAINS for DUCTILE IRON PIPES and FITTINGS)
- Possible adjustment: dimension X  $\pm$ e (50mm DN 300-2000)
- Angular deflection in degree + or - 2 degrees
- Flanges: dimensions in conformity with ISO 7005-2, ISO 2531, EN 1092-2.

## Assembly and start up

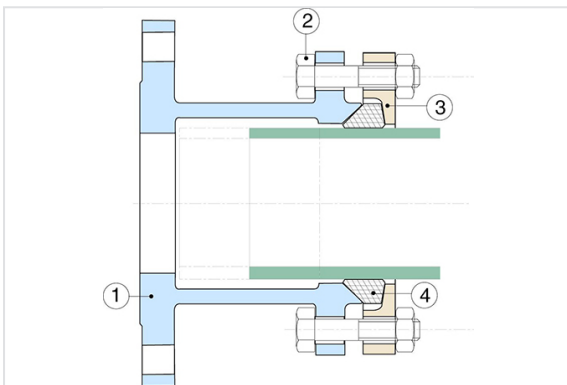

## Description

The flange adaptor type PV allows the connection between a flange and a spigot

An adjustment of the pipe length is possible in the adjustment area ( $\pm$ e).

During the fitment of the pipe (measurement X) in central position the flange adaptor enables an angle of 4°.

## Transport

The transport of the pieces must be done professionally in order to avoid damages on the material.

## Storing

The flange adaptors must be protected from bad weather and pollution. During a long storage period a protection against UV is necessary.

## Assembling in the pipe network

It is necessary to control that the flanges to be connected are clean and not damaged. The pipe to be connected must be perfectly round.

## Assembly

- Implementation of the connection (screws and flat tightening seals to be supplied on site).
- Unscrew the nuts (2) and remove the counterflange (3) and the tightening seal (4).


- Write the measurement X on the spigot of the pipe.
- Slide the counterflange (3) and the tightening seal (4) on the spigot of the pipe.
- Slide the pipe right into the flange adaptor. If possible it would be necessary to make the assembly in average position.
- Slide the tightening seal (4) and the counterflange (3) against the body (1).
- Connect the body (1) and the counterflange (3) with the nuts (2) tightening them in cross.
- The flange adaptor is then ready for operation.

DN	Type PV PN10	Type PV PN16	Type PV PN25	Adjustment $\pm e$
mm	Measurement X (mm)	Measurement X (mm)	Measurement X (mm)	mm
80	70	70	75	40
100	70	70	75	40
125	70	70	75	40
150	70	70	75	40
200	70	70	75	40
250	90	90	90	50
300	90	90	110	50
350	90	90	105	50
400	90	90	105	50
450	90	90	105	50
500	90	90	105	50
600	80	90	100	50
700	80	90	100	50
800	90	90	130	50
900	90	170	115	50
1000	170	180	180	50
1200	170	180	170	50
1400	160	220	260	50
1600	150	210	260	50
1800	180	240	260	50
2000	180	240	260	50

Tightening torque	
Nuts	Nm
M16	55 $\pm 4$
M20	110 $\pm 10$

Tightening torque	
Nuts	Nm
M24	190 ±10
M27	280 ±15
M30	380 ±20

## Material and coatings

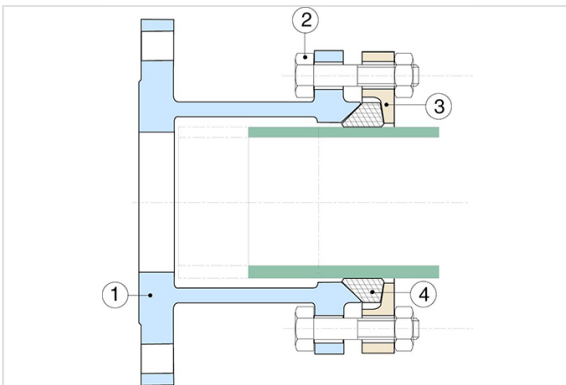

Item	Description	Material	Coating
1	Body	Steel EN 10025 S235JRG2	Epoxy mini 300 microns
2	Bolts, Washers	Steel EN 10025 S235JRG2 or S335J2G3 Class 6/8	Hot dipped galvanized 40μ
3	Flange Ring	Steel EN 10025 S235JRG2	Epoxy mini 300 microns
4	Sealing Ring	Elastomer type EPDM	

*The information on this sketch is, to the best of our knowledge correct at the time of printing. However Saint-Gobain are constantly looking at ways of improving their products and services therefore reserve the right to change without prior notice, any of the data shown. Any orders placed will be subject to our Standard Conditions of Sale, available on request.*