



Fire hydrant C9+ Traffic DN80-100 - Storz outlets

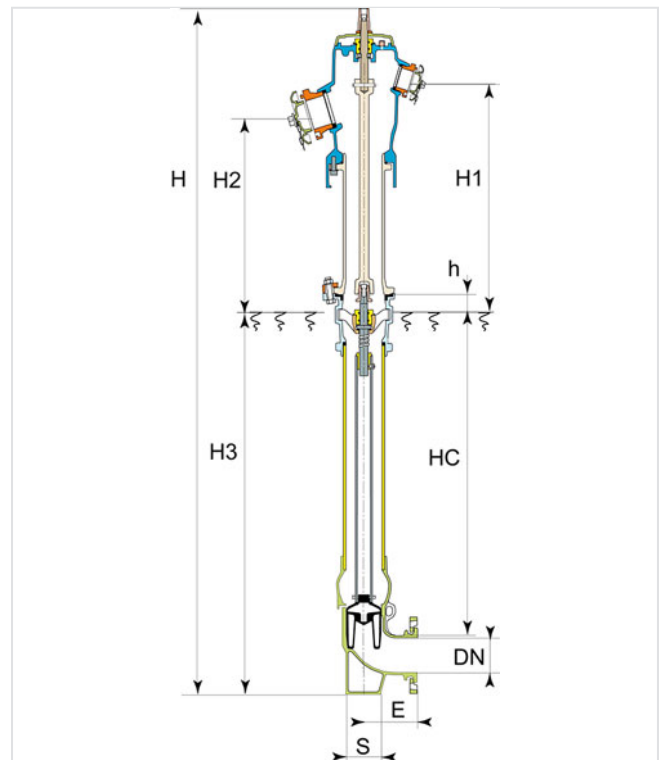

- Operating triangular cap 39mm
- Bended valve box or straight valve box
- Automatic drainage function
- Outlets: 2 Storz lateral outlets and 1 Storz frontal outlet or 1 Storz frontal outlet

DN (mm)	Version	Outlets	P=HC (mm)	H (mm)	H1 (mm)	H2 (mm)	H3 (mm)	E (mm)	S (mm)	Mass (kg)	References
80	Bended box	2x2" + 1x2" ¹ / ₂	969	1961	652	553	1121	123	95 x 80	78.00	RYA80DCBJB
80	Bended box	1x2" ¹ / ₂	969	1961		553	1121	123	95 x 80	78.50	206082
80	Straight box	2x2" + 1x2" ¹ / ₂	1249	2248	652	553	1408	165	180x180	108.00	RYA80DQCJB
100	Bended box	2x2" ¹ / ₂ + 1x4"	1006	2040	643	538	1175	152	100 x 90	76.00	166704
100	Bended box	1x2" ¹ / ₂ + 1x2" + 1x4"	1006	2040	643	538	1175	152	100 x 90	76.00	164247
100	Bended box	2x2" + 1x2" ¹ / ₂	1006	2040	643	538	1175	152	100 x 90	78.00	183220
100	Bended box	2x2" ¹ / ₂ + 1x4"	600	1640	643	538	775	152	100 x 90	66.00	166705
100	Bended box	1x2" ¹ / ₂ + 1x2" + 1x4"	600	1640	643	538	775	152	100 x 90	66.00	164248
100	Straight box	2x2" ¹ / ₂ + 1x4"	1250	2278	643	538	1438	180	200x200	119.50	175991
100	Straight box	2x2" ¹ / ₂ + 1x4"	1500	2528	643	538	1688	180	200 x 200	125.00	207230

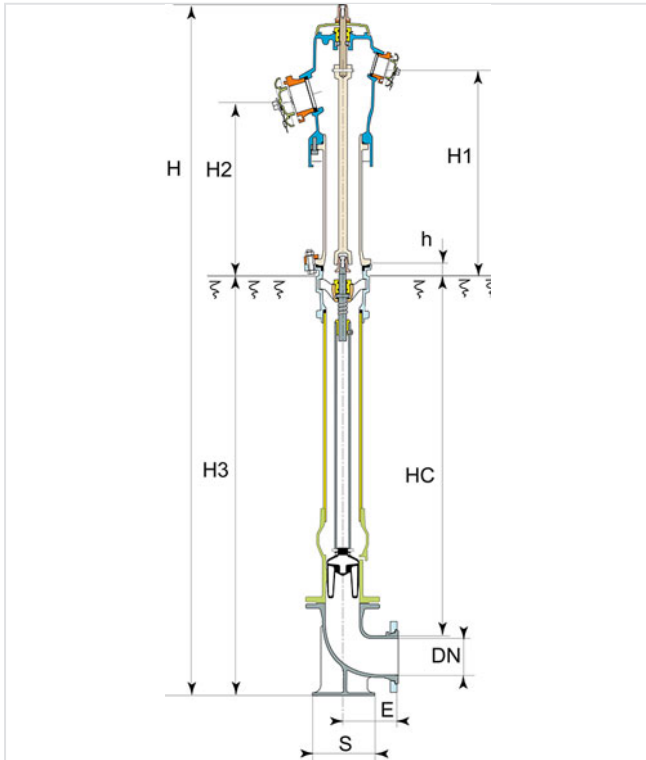


Field of use

Fire hydrants pillar or underground type are designed, according to applicable standards and regulations, for exclusive use of fire protection and using drinking water or raw water network.

They must be handled and used in strict compliance with the recommendations and best practice by personnel trained with these recommendations.

These devices must be inspected periodically (as required by regulations or recommended instructions) to verify and maintain their proper and safe operation.

Material and coating

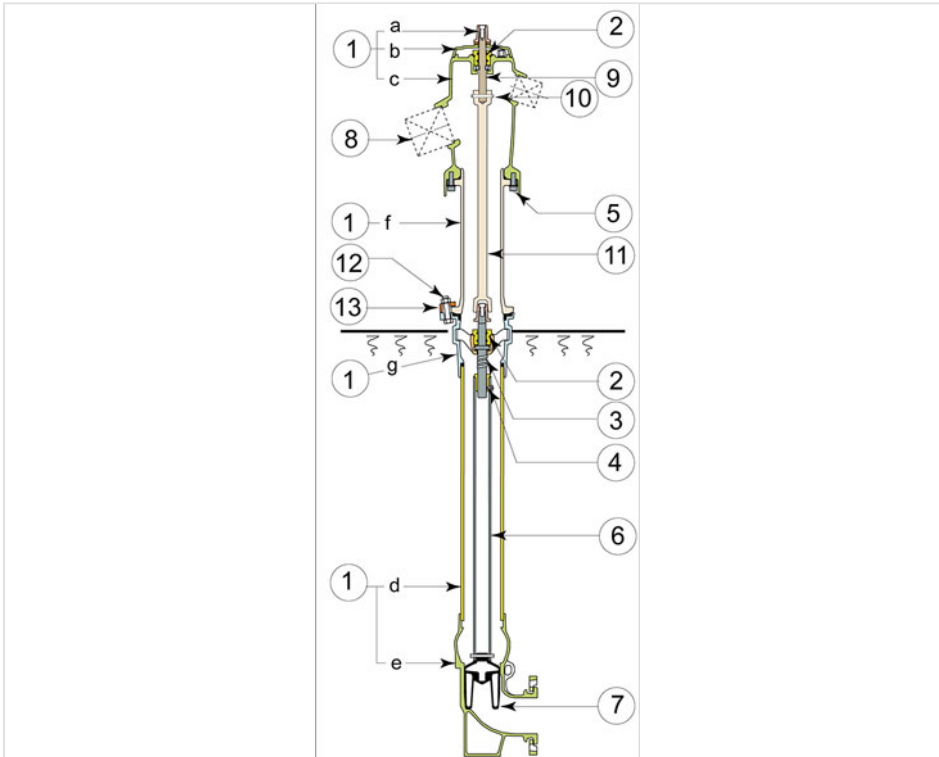

Item	Designation	Material	Coating
1	1a -Operating cap	Ductile iron GS EN GJS 400-15 or 500-7 EN 1563	Dacromet + grey Polyurethane 20 µm
	1c -Upper body	Ductile iron GS EN GJS 400-15 or 500-7 EN 1563	Red-brown Epoxy powder 250 µm + red Polyurethane 40 µm
	1f - Lower Body	Ductile iron GS EN GJS 400-15 or 500-7 EN 1563	Epoxy powder 250 µm + red Polyurethane 40 µm
	1 g - Screwed box	Ductile iron GS EN GJS 400-15 or 500-7 EN 1563	Epoxy powder 250 µm + red Polyurethane 40 µm
	1d-Extension tube	Ductile iron GS EN GJS 400-15 or 500-7 EN 1563	Blue Epoxy powder 250 µm
	1e -Valve box	Ductile iron GS EN GJS 400-15 or 500-7 EN 1563	Blue Epoxy powder 250 µm
	1b- Cover	Polyamide P A 6	Red polyurethane paint
2	Upper and lower bush	Brass type Cu Zn 39 Pb 2EN 12164	
3	Operating stem	Steel type X20 Cr 13 EN 10088-3	
4	Operating nut	Brass type Cu Zn 40 Pb 2 EN 12164	
5	Fixing screw	Steel type CL 8/8	Bichromated zinc
6	Operating rod	Steel type Tu 56 B NF EN 10240	Galvanized
7	Valve	Ductile iron GS EN GJS 400-15 or 500-7 EN 1563	Encapsulated EPDM
8	Outlets	Depending on models	



Item	Designation	Material	Coating
9	Operating shaft	X20 Cr 13 EN 10088-1	
10	Pin	X20 Cr 13 EN 10088-1	
11	Operating spindle	(OS) Forged steel C35 - NF EN 10083-1	25 microns black cataphoresis
12	Bolts and nuts	Steel type CL 8/8	Bichromated zinc
13	Breakable traffic clamping shim	Ductile iron	250 microns fusion bonded blue epoxy + red polyurethane

Notice [NPPI 01 A](#)

The information on this sketch is, to the best of our knowledge correct at the time of printing. However Saint-Gobain are constantly looking at ways of improving their products and services therefore reserve the right to change without prior notice, any of the data shown. Any orders placed will be subject to our Standard Conditions of Sale, available on request.